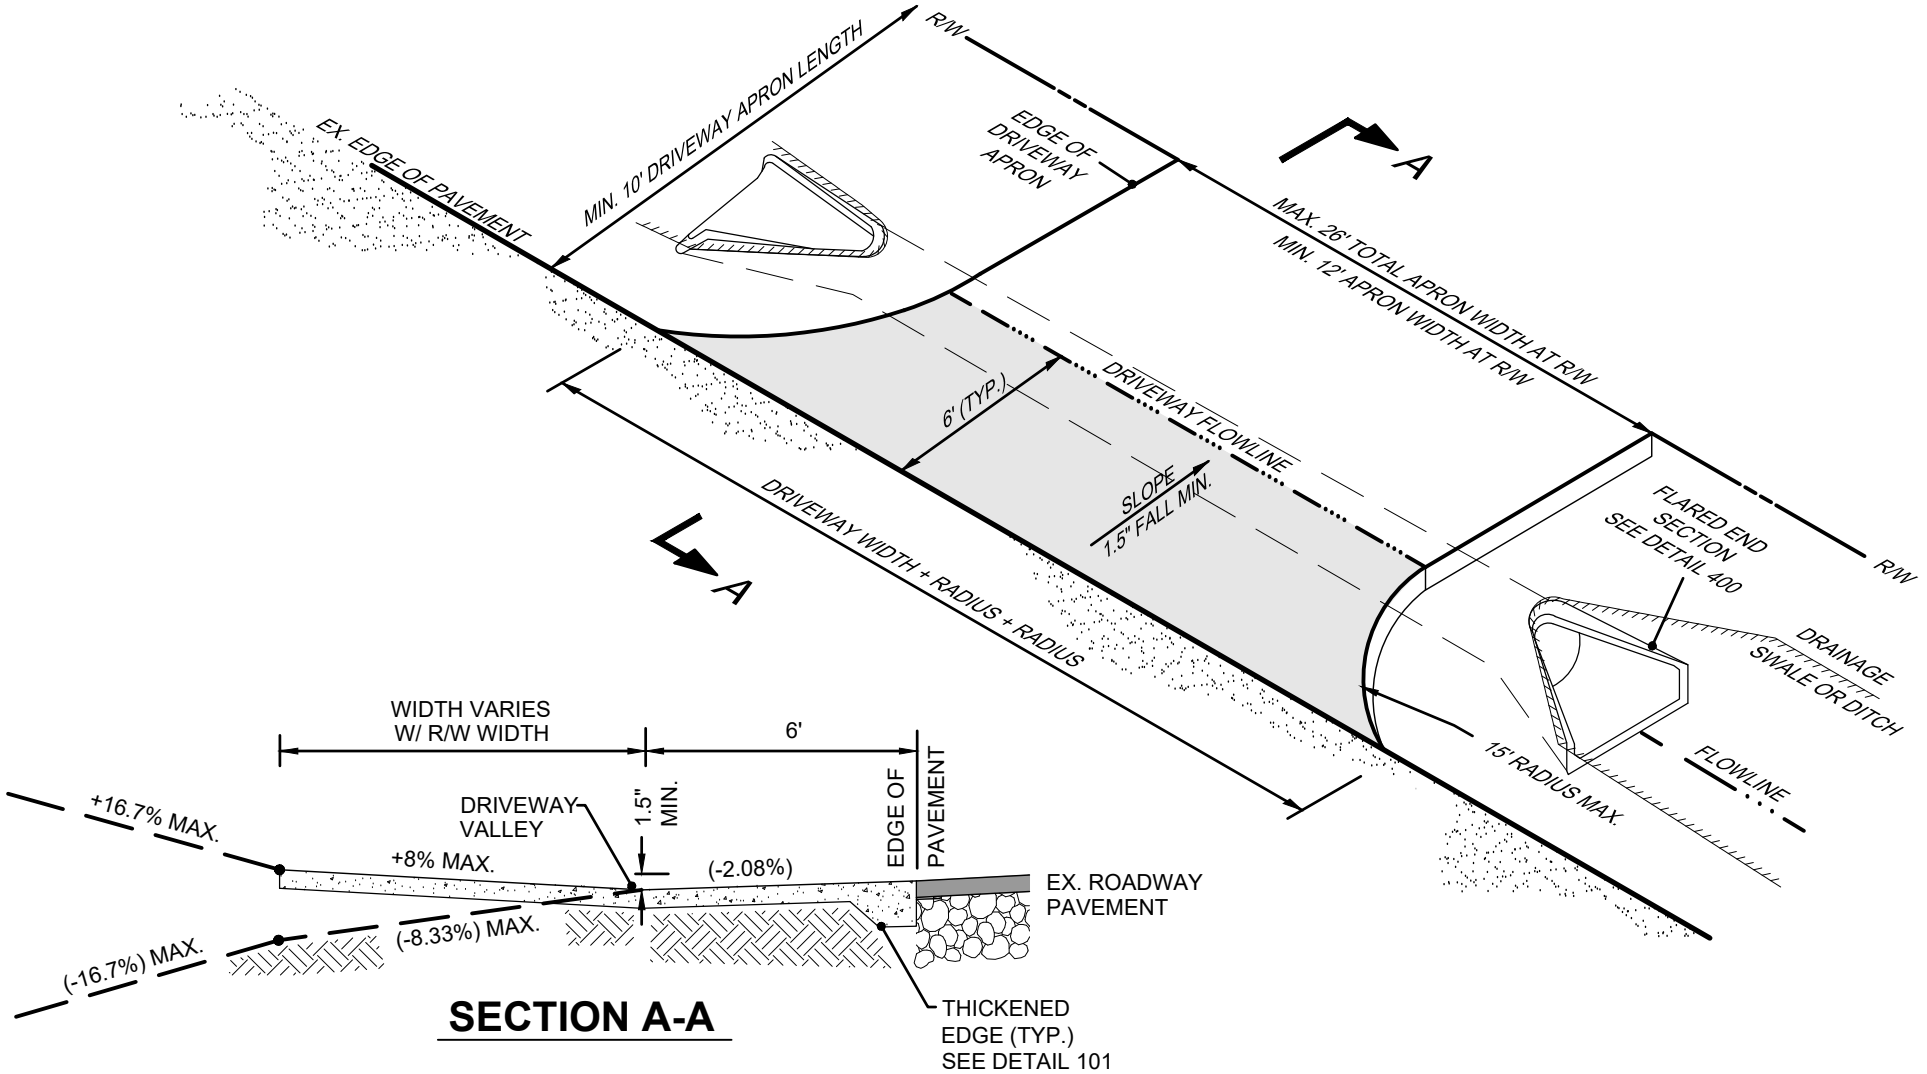

SECTION A-A

NOTES:

1. All driveways must meet the current Town driveway requirements and NCDOT requirements for spacing, sight distance, and offsets from property lines and intersections.
2. Special conditions may warrant exceptions to this detail. Subject to approval by Town Engineering or Public Works Director.
3. The driveway entry radius can be tapered in lieu of a radius connection with a maximum 10' taper length and width.
4. Driveway aprons shall be constructed of a min. 4" thick, 3000 psi concrete or 6" ABC base course with a 2" asphalt surface course.
5. Driveway street approach shall be stabilized prior to commencing with construction.

TOWN OF NAGS HEAD
DEPARTMENT OF ADMINISTRATION
P.O. BOX 99
NAGS HEAD, NC 27959
252.441.7016 • www.nagsheadnc.gov

TYPICAL RESIDENTIAL DRIVEWAY DETAIL

SCALE: NONE
ISSUE DATE: 7-9-2015
REVISION DATE: 1-3-2019
SHEET NO: 1 OF 1
DRAWN BY: DMR

DETAIL NO.: 100