




CONCRETE CURB & GUTTER

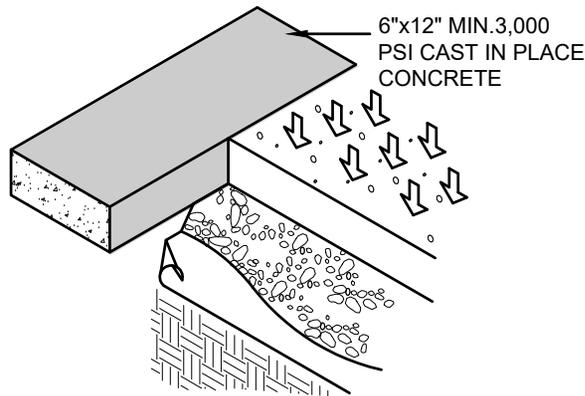


CONCRETE CURB & GUTTER

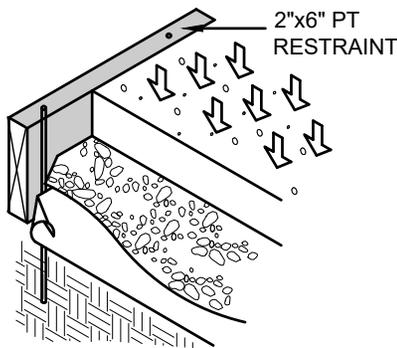

WOOD EDGE RESTRAINT

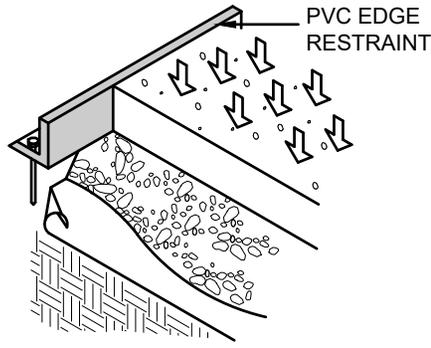

PVC EDGE RESTRAINT

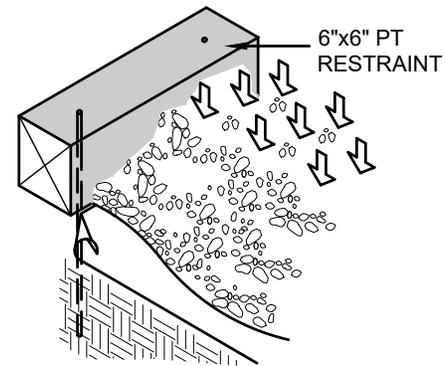

TIMBER EDGE RESTRAINT

(THIS APPLIES TO GRAVEL INSTALLATIONS ONLY)

NOTES:

1. PVC Edge restraint and attachments shall be installed in accordance with manufacturer recommendations. PVC Edge restraints shall be used on paver installations ONLY.
2. Cast in place concrete compressive strength shall be a minimum of 3,000 psi. Wood edge restraint shall be pressure treated and drilled with 3/8 dia holes spaced at 3'-0" on center. 48" lengths of #3 rebar stakes shall be placed through the drilled holes and embedded in the soil below and cut flush to the top of restraint.
3. The edge restraint shall be continuous along the pavement length.
4. Refer to Detail 103 and Detail 105 for pavement section material type and thickness.



TOWN OF NAGS HEAD
DEPARTMENT OF PUBLIC WORKS
P.O. BOX 99
NAGS HEAD, NC 27959
252.441.7016 • www.nagsheadnc.gov

**TYPICAL RESIDENTIAL PERMEABLE
PAVER EDGE RESTRAINT DETAILS**

SCALE: NONE
ISSUE DATE: 7-9-2015
REVISION DATE: 1-3-2019
SHEET NO: 1 OF 1
DRAWN BY: DMR

DETAIL NO.:
104
9